

# Revisiting the Tripping Logic of the DER\_A Model for Power System Stability Studies

Jorge Sancho  
EPER-Lab, University of Costa Rica  
San José, Costa Rica  
jorge.sanchochaverri@ucr.ac.cr

Francisco Escobar, and Gustavo Valverde  
Power Systems Laboratory, ETH Zurich  
Zurich, Switzerland  
{escobarprado, valverde}@eeh.ee.ethz.ch

**Abstract**—The increasing amount of Distributed Energy Resources (DERs) in Distribution Networks (DNs) has awakened the interest of system operators to represent how DERs will react to large disturbances. These units will respond according to the ride-through capability curves, the tripping logic settings, the local voltage magnitude, and frequency measurements.

In this paper, we show the limitations of the well-known DER\_A model and propose changes to represent better the ride-through capabilities and the tripping of a population of DER units. We also show the need for more than one aggregation in the same bus to represent the response of the old and modern DER technologies.

To validate the new model, we run dynamic simulations of a Transmission Network (TN) and DNs with hundreds of DER units modeled in detail. The simulation results show that the proposed changes improve the representation of a population of DERs during low-voltage and low-frequency events.

**Index Terms**—DER, dynamic simulation, models, ride-through, tripping.

## I. INTRODUCTION

The energy transition of most countries to combat climate change has boosted the integration of renewable energy sources in power systems, including DERs. These are medium to small-scale electric power sources not directly connected to the bulk power system [1]. The increasing installed DER capacity, especially inverter-interfaced distributed generators, has motivated different studies regarding their impact [2], for example, to analyse the impact of DERs in TNs [3].

The TN operators are searching for efficient ways to represent the behaviour of DERs during large disturbances without explicitly modelling them or the voltage level they are connected to. This necessity has led to the development of aggregate DER models in the last decade, such as the discontinued PVD1 model [4] or the DER\_A model currently used in North America [5]. The latter is subject to continuous review and improvements as the proportion of legacy DERs connected in the system reduces compared to that of modern DERs with more strict Ride-Through (RT) requirements, compliant with the Institute of Electrical and Electronics Engineers (IEEE) Std. 1547-2018 [1].

A realistic representation of DERs in power system stability studies is crucial for preventing massive disconnections of DERs triggered by large disturbances, which could result in further voltage and frequency problems. The latest version

of the DER\_A model uses a simple representation of the temporary and permanent disconnection of hundreds or thousands of DER units in the distribution system due to voltage and frequency events. Issues with this implementation were originally reported in [6].

In this paper, combined simulations of TNs and DNs subject to large disturbances are run to show that the latest version of the DER\_A model may not effectively represent the tripping of small-scale DER units dispersed in the DNs. Because of this, several changes in the DER\_A model are proposed. The modified DER\_A model, called DER\_A\_RT, includes a more sophisticated tripping logic that emulates the Voltage Ride-Through (VRT) and Frequency Ride-Through (FRT) characteristics defined in IEEE Std. 1547-2018.

The remainder of this paper is organized as follows: The RT characteristics defined in the IEEE standard are summarised in Section II. An explanation of the DER\_A model and its limitations is presented in Section III. The proposed modifications to the aggregate model are presented in Section IV, while the simulations used to compare the RT and trip representations are presented in Section V. Finally, the conclusion are drawn in Section VI.

## II. IEEE STANDARD 1547

The IEEE developed the 1547 standard to address the challenges of integrating DERs to the Electric Power System (EPS). This standard focuses on the technical specifications that DERs must have to interconnect with the EPS, establishing requirements of performance, operation, testing, safety considerations, and maintenance [1].

In its first version, IEEE Std. 1547-2003 [7], the standard prescribes the response to EPS abnormal conditions by defining voltage and frequency thresholds at which the DER must cease to energise, given a specific duration. This is depicted in Fig. 1. The latest version of the standard, IEEE Std. 1547-2018 [1], requires better performance on the DERs connected to DNs.

New capabilities were defined to align the DER requirements with the reliability requirements of the EPS, also searching for an improvement of reliability with the increasing DER penetration [8]. The new capabilities include the RT characteristics, which sustain the availability of the DER

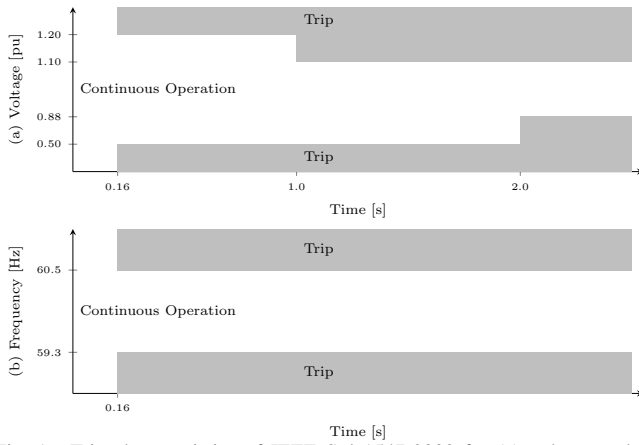


Fig. 1. Trip characteristics of IEEE Std. 1547-2003 for (a) voltage and (b) frequency.

under abnormal conditions. For this, the standard defined the following three categories of DERs [8]:

- **Category I:** It is derived from the German guide BDEW for synchronous generators, so it considers the limitations of this type of generation. Most commonly-used DERs can achieve this RT definition, but the RT performance is inconsistent with the reliability standards imposed by the EPS. High DER penetrations that only follow this category could be detrimental to the EPS reliability.
- **Category II:** It covers minimum EPS reliability needs. The performance capabilities are attainable by inverter-based resources and possibly other DER technologies. The IEEE working group of Std. 1547-2018 expects this category to have the most widespread adoption.
- **Category III:** It is based on California Rule 21 and Hawaii's Rule 14H. It provides the longest duration and the widest band for RT capability and can be achieved by inverter-based systems. The standard was amended in [9] to provide more flexibility to this category, as power-distribution engineers deemed the low-voltage trip times to be very long in the original version.

The trip and RT requirements specified for each category are shown in Fig. 2. The requirements for voltage conditions vary by category, while those for frequency remain constant across all categories. The explanation used by [1] for the voltage trip requirements is as follows: when any applicable voltage is less than an undervoltage threshold, or greater than an overvoltage threshold, the DER shall cease to energise the EPS and trip within the corresponding clearing time. The same explanation applies to frequency tripping requirements.

In the case of VRT and FRT, the standard defines different operating zones. When the voltage or frequency values are outside the RT operation region parameters (value and cumulative duration), requirements for continued operation (RT), or restoring output after the voltage disturbance, shall not apply [1]. The RT zones are defined as follows:

- **Cease to energise:** Cease active power injection and limit the reactive power exchange. If the aggregate DER

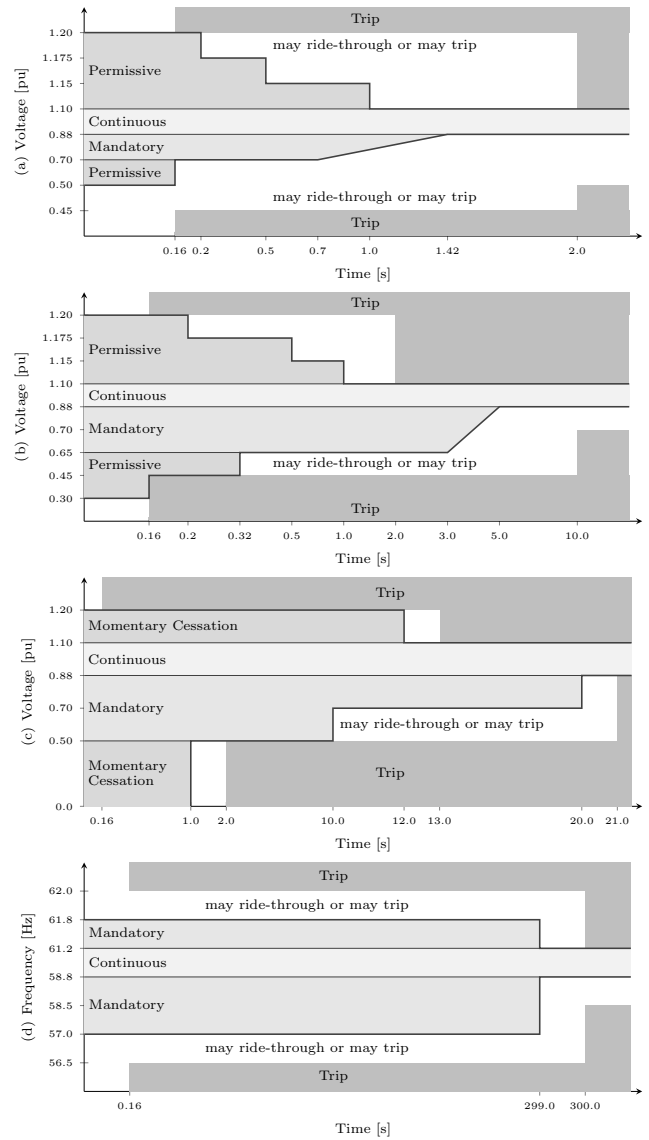


Fig. 2. RT characteristics minimum requirements for (a) Category I VRT, (b) Category II VRT, (c) Category III VRT, and (d) FRT of all categories.

nameplate rating is less than 500 kVA, the exchanged reactive power must be less than 10% of the nameplate DER rating. Otherwise, the exchanged reactive power must be less than 3% of the nameplate DER rating.

- **Momentary cessation:** Temporary cease to energise, in response to a disturbance, with the capability of immediately restoring the output when the voltage returns to the continuous or mandatory operation region.
- **Mandatory operation:** Required continuance of active current and reactive current exchange of DER with the EPS as prescribed, even in the presence of a disturbance in the EPS.
- **Permissive operation:** The DER performs RT either in mandatory operation or in momentary cessation, in response to a disturbance.
- **Continuous operation:** Exchange of current between the DER and an EPS within prescribed behaviour.

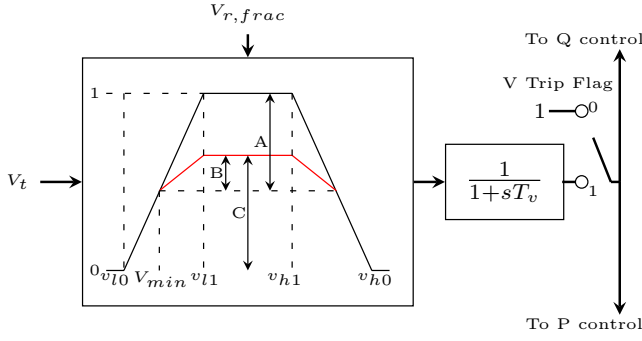


Fig. 3. Fractional tripping block in DER\_A.

### III. DER\_A MODEL

The DER\_A is a model that represents the aggregate behaviour of many small-scale, distributed, inverter-based generators in positive-sequence stability studies [5]. This aggregate model was developed by the Western Electricity Coordinating Council (WECC) and is a reduced version of the second generation of generic models for large-scale renewable generators, with approximately one third of its parameters. Furthermore, this model has been tested and validated in various simulation software [10].

The DER\_A consists basically of the following parts: a reactive power-voltage control loop, an active power-frequency control loop, a frequency tripping logic, an active-reactive current priority logic, a fractional tripping logic, and a voltage source representation. A detailed explanation of each of these parts can be found in [5], [6], [11].

#### A. Voltage and frequency tripping logic

To emulate the response of the DERs to abnormal conditions defined in the Std. 1547-2018, the DER\_A model has a fractional tripping and frequency tripping logic. This logic tries to represent the voltage trip and VRT requirements defined in the standard. Also, this logic attempts to emulate the voltage diversity along a distribution network since DERs do not necessarily trip simultaneously.

A graphical representation of the fractional tripping block is presented in Fig. 3. This block defines two thresholds for undervoltages ( $v_{l1}$  and  $v_{l0}$ ) and two for overvoltages ( $v_{h1}$  and  $v_{h0}$ ), each one with its respective timer. These thresholds are connected by a black line representing the fraction of active DERs in the aggregation, considering the voltage drop along the distribution networks. Therefore, if the voltage is lower than  $v_{l1}$  or higher than  $v_{h1}$ , only a fraction of the DERs will inject power to the EPS, and if the voltage is lower than  $v_{l0}$  or higher than  $v_{h0}$ , all the aggregated DERs are inactive. The block also has an input  $V_{r,frac}$ , which is used to define the fraction of DERs that will remain active after the fault is cleared (typically those with a modern technology), resulting in the red line shown in Fig. 3.

The frequency-tripping block incorporates the logic depicted in Fig. 4. This logic only has two thresholds, one for underfrequencies and another for overfrequencies. Also, each

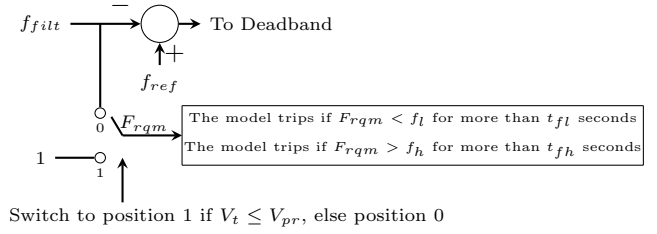


Fig. 4. Frequency tripping block in DER\_A.

TABLE I

RECOMMENDED PARAMETER VALUES FOR DER\_A TRIPPING LOGIC [11].

Parameter	IEEE 1547-2003	70% of 2003 30% of 2018	30% of 2003 70% of 2018	IEEE 1547-2018
$v_{l0}$	0.44 pu	0.44 pu	0.44 pu	0.44 pu
$v_{l1}$	0.49 pu	0.49 pu	0.49 pu	0.49 pu
$v_{h0}$	1.2 pu	1.2 pu	1.2 pu	1.2 pu
$v_{h1}$	1.15 pu	1.15 pu	1.15 pu	1.15 pu
$t_{vl0}$	0.16 s	0.16 s	0.16 s	0.16 s
$t_{vl1}$	0.16 s	0.16 s	0.16 s	0.16 s
$t_{vh0}$	0.16 s	0.16 s	0.16 s	0.16 s
$t_{vh1}$	0.16 s	0.16 s	0.16 s	0.16 s
$V_{r,frac}$	0	0.3	0.7	1.0
$f_l$	59.3 Hz	58.5 Hz	57.5 Hz	56.5 Hz
$f_h$	60.5 Hz	61 Hz	61.5 Hz	62 Hz
$t_{fl}$	0.16 s	0.16 s	0.16 s	0.16 s
$t_{fh}$	0.16 s	0.16 s	0.16 s	0.16 s

threshold has its own timer, which defines the seconds that the frequency can stay below  $f_l$  or above  $f_h$ . Since the frequency is a global variable, the entire DER\_A model will trip if one the conditions shown in Fig. 4 is met.

For the parameter values of both tripping logics, reference [11] recommends using the values presented in Table I, which includes cases of mixed technology penetrations, i.e., penetration of both old and modern DER technologies.

Regarding the voltage threshold values, reference [11] explains that the Electrical Power Research Institute (EPRI) has demonstrated that a voltage drop of 5% along the distribution system is a reasonable value. This means that when the voltage at the substation busbar is at 0.49 pu, the voltage in DERs along the DN is probably at 0.44 pu, reaching one of the trip thresholds for Category II. For this reason, the value of  $v_{l1}$  (0.49 pu) is 0.05 pu greater than  $v_{l0}$  (0.44 pu), using the Category II low voltage trip threshold value as  $v_{l0}$ . The same applies to  $v_{h1}$  (1.15 pu) and  $v_{h0}$  (1.2 pu).

In the case of the frequency threshold values, reference [11] recommends that, for mixed penetrations of old and modern DERs, the values of  $f_l$  and  $f_h$  fall within the range defined in the IEEE Std. 1547-2003 and Std. 1547-2018, depending on the penetration of each technology.

#### B. Issues found in the tripping logic of DER\_A

In a previous work [6], the RT representation of the DER\_A was compared with that of a population of DERs modeled in detail by the so-called DER\_D [12], using dynamic simulations. The DER\_D is a model that represents a single small-scale DER unit located in the distribution network, meant to

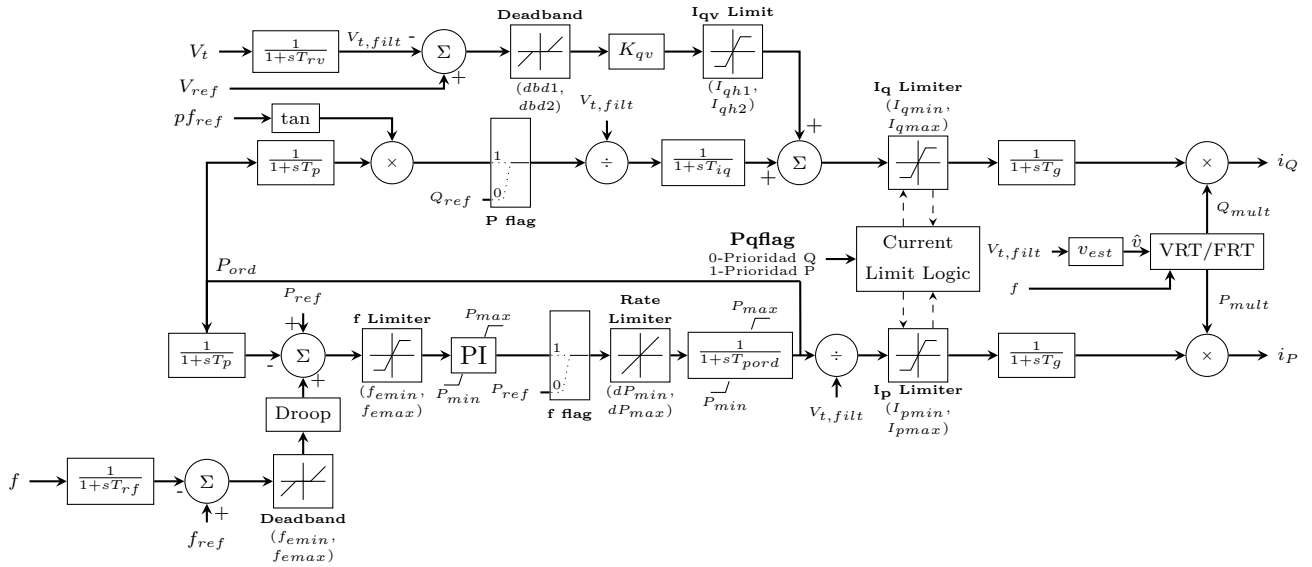


Fig. 5. DER\_A\_RT model block diagram.

be embedded in Transmission-Distribution (T-D) simulations for transmission system studies.

In the comparison, it was found that the DER\_A may not be capable, with its limited number of thresholds, of representing the RT capabilities of a mixed aggregation of DERs. For example, in the fractional-tripping logic the only adjustable thresholds are  $v_{l0}$  and  $v_{h0}$ , as  $v_{l1}$  and  $v_{h1}$  are used to represent the voltage drop along the distribution networks. With only two adjustable thresholds, it is impossible to represent all the RT zones defined in the IEEE Std. 1547-2018 (see Fig. 2).

The limited number of thresholds also affects the frequency-tripping logic. In [6], it was demonstrated that the way the thresholds are chosen in [11] to represent a mixed penetration of DERs leads to errors in the tripping of the DER aggregation. This results in inappropriate trips for underfrequencies in modern-technology DERs, because the configured trip threshold in the DER\_A was higher than the one used by the individual DERs, or the no trip of the old DERs, as the trip threshold in DER\_A was lower than the one used in this technology.

#### IV. PROPOSED AGGREGATE MODEL

To resolve the issues found in the tripping logic of the DER\_A, a new logic that incorporates the characteristics defined by IEEE Std. 1547-2018 for RT and trip is proposed. As a result, a new aggregate model called DER\_A\_RT is obtained. The block diagram is presented in Fig. 5.

The main change compared to the DER\_A model is that the fractional tripping and frequency tripping blocks are replaced by a single block called VRT/FRT. This block is responsible for placing the simulated aggregation of DERs in the states defined by the zones of IEEE Std. 1547-2018.

The general structure used for the VRT/FRT block is shown in Fig. 6. First, the structure has the VRT and FRT blocks, directly implementing the RT curves presented in Fig. 5. To

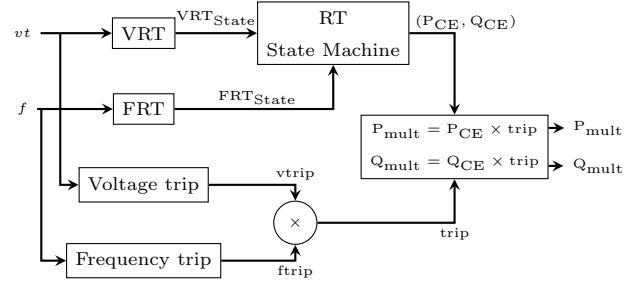


Fig. 6. General structure of the VRT/FRT block in DER\_A\_RT model.

achieve this, the blocks use finite states machines to transition between zones and timers to define when to enter the “may ride-through or may trip” zone.

The timers are designed following the indications of [13], which is a standard that reviews the interconnection of inverter-based resources to the transmission system. In this standard, the time is taken per zone (each zone with its own timer), starting the timer when the voltage or frequency value enters the RT zone and stopping it when the value returns to the upper zone for low voltage or low frequency cases, or the lower zone for high voltage or frequency cases.

The outputs of the VRT and FRT blocks are the states in which their internal state machine is located. The possible states in the VRT block are: 1 for normal operation, 2 for high voltage cease, 3 for low voltage cease and 4 for the “may ride-through or may trip” zone. The FRT block has two states: 1 for normal operation and 2 for the “may ride-through or may trip” zone. The outputs from VRT and FRT are used in another state machine that defines the percentage of active ( $P_{CE}$ ) and reactive ( $Q_{CE}$ ) power injected, relative to the power value during continuous operation, by the aggregate model.

The structure of this state machine is presented in Fig. 7. The state machine has a  $Q_{cease}$  variable to define the percent-

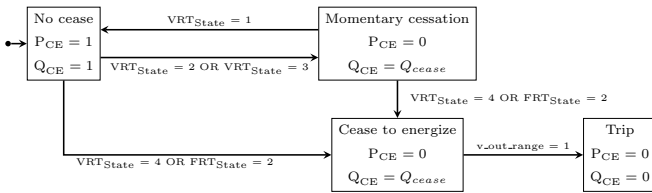


Fig. 7. RT State Machine used in the VRT/FRT block.

age of reactive power injected when the DERs are in cease mode, as defined in Section II. Also, it has a  $v_{out\_range}$  parameter to select the aggregation behavior in the “may ride-through or may trip” zone.

Another group of state machines is used for the voltage and frequency tripping logic. In this case, there are only two possible states, 0 for trip and 1 for normal operation. The values of the voltage trip and frequency trip are multiplied and passed to another block that also receives the result given by the RT State Machine block. In this last block, a multiplication is performed to define the final output of the VRT/FRT block that is then used in the DER\_A\_RT model.

The proposed model incorporates a  $v_{est}$  block which contains a gain that multiplies the  $V_{t, filt}$  signal and passes the result to the VRT/FRT block. This is done to approximate the voltage used in the RT to the terminal voltage seen by most of the individual DERs. In this paper, the  $V_{t, filt}$  signal is multiplied by the average voltage magnitude of the individual DERs. The average voltage is calculated by conducting multiple T-D simulations with the test system, obtaining the voltage magnitude of the DERs for different perturbations at different times, and applying linear regression to obtain the gain utilized in  $v_{est}$ . In future work, efforts will be made to improve how the voltage of individual DERs is estimated for this aggregate model.

The proposed model has 1.3 times the number of continuous states of the existing DER\_A model and 1.4 times the number of discrete variables. In addition, for simulating a mix of vintage and modern technologies, one requires connecting in parallel two instances of the new DER model instead of one.

Finally, the main limitation of this model is that the voltage estimation requires some prior knowledge of the voltage diversity across the distribution network. The proposed model also inherits from the existing DER\_A other limitations not pertaining to the ride-through/tripping logic, such as simplified modeling of the power converter, predefined voltage- and frequency-control modes, and suitability only for RMS dynamic simulations (i.e., using the phasor approximation).

## V. SIMULATIONS RESULTS

The simulations were carried out in RAMSES, a time-domain power system simulator [14], using the 50 Hz test system of Fig. 8. The two aggregate DER models are connected to bus 47 and they inject a total of 2 MW. The main purpose of these simulations is to highlight the issues of the DER\_A model and verify if these are addressed by incorporating the improvements proposed in Section IV.

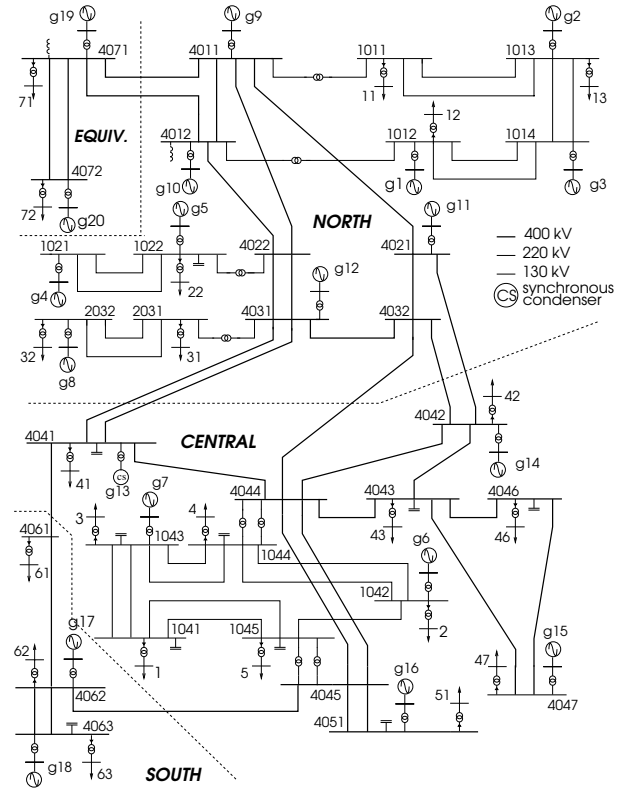


Fig. 8. One-line diagram of the TN [16].

Detailed T-D simulations are carried out to compare the response of the individual DERs against the aggregate DER\_A and DER\_A\_RT models. To accomplish this, the detailed model DER\_D is used [12], which represents small-scale DERs in the low voltage (LV) network. The individual units are located in DNs generated with the method explained in [15], where aggregate loads and generators are disaggregated into several DNs. The number of individual DERs that result after the disaggregation is 1160.

In the test system, 60% of the DERs are of modern technology, following IEEE Std. 1547-2018. The other 40% consists of vintage technology, following IEEE Std. 1547-2003. The modern technology is represented as DERs of Category II, because IEEE expects this category to be the most adopted. To represent this mix of technologies in the new model DER\_A\_RT, two aggregations are used in bus 47. This is not done for DER\_A, since the model already attempts to consider the presence of both types of technologies.

In the simulations, the DER\_A\_RT and DER\_D models use the VRT and voltage trip characteristics of Fig. 1 and Fig. 2, while the DER\_A uses the values from Table I (adapting the values to the penetration level of each technology). As the test system operates in 50 Hz, the frequency thresholds were converted from 60 Hz to 50 Hz (keeping the same pu values), resulting in the FRT and frequency trip characteristics of Fig. 9. In the case of the DER\_A model, the parameters values are  $f_l = 48.02$  Hz,  $f_h = 51.17$  Hz and  $V_{r,frac} = 0.6$ . The permissive operation zone is chosen as momentary cessation



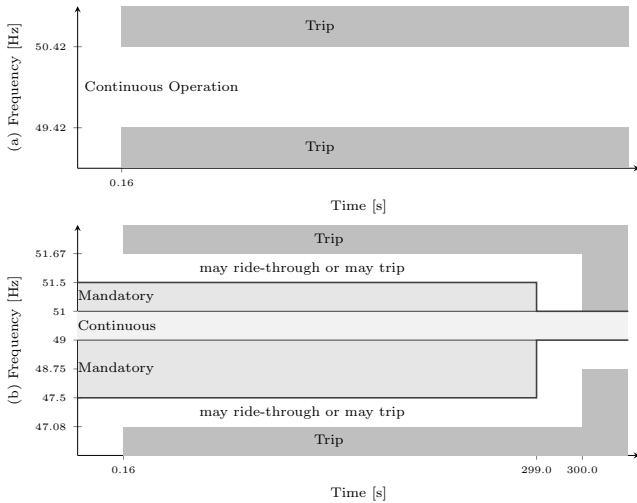


Fig. 9. Frequency characteristics of IEEE for (a) Std. 1547-2003 (b) Std. 1547-2018, based on 50 Hz.

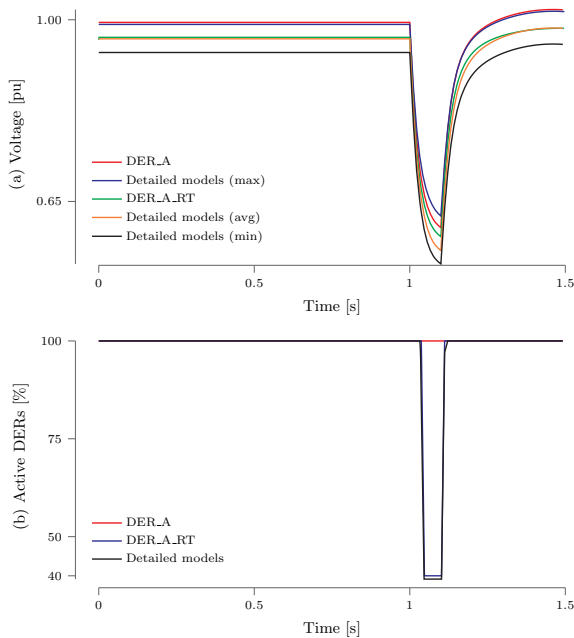


Fig. 10. Response to a three-phase short circuit near bus 4047 with  $30\ \Omega$  fault impedance (Case 1).

and the “may ride-through or may trip” zone is configured for cessation.

For the comparison between DERs models, three different cases are simulated. In the first two cases, the low VRT response is compared, while in the last case, a low FRT comparison is made.

#### A. Case 1

The applied disturbance is a three-phase short circuit near bus 4047 with  $30\ \Omega$  fault impedance. This disturbance is cleared 100 ms later by opening the line 4043-4047. The results of the simulations are shown in Fig 10.

In Fig. 10 (a) the voltages of the DER models are shown. For the detailed models (DER\_D), the maximum voltage (the

TABLE II  
PERCENTAGE OF DERs IN MOMENTARY CESSATION AFTER DISTURBANCE FOR DIFFERENT MIXES OF TECHNOLOGIES (CASE 1).

Percentage (modern / vintage)	DER_D (benchmark)	DER_A	DER_A_RT
50% / 50%	48.7%	100%	50%
60% / 40%	39.2%	100%	40%
70% / 30%	30.1%	100%	30%

DER unit closest to the substation), the minimum voltage (the DER unit furthest to the substation), and the average voltage among all DERs in the system are displayed. In the DER\_A, the terminal voltage is plotted, while for the DER\_A\_RT, the estimated voltage used by the RT logic is plotted. By using this estimated voltage, a value close to the average voltage of individual DERs is obtained, improving the representation of their overall condition. However, there is a difference between the voltage estimated by DER\_A\_RT and the average voltage value when the disturbance is introduced, so there is room for improvement in the voltage estimation.

Figure 10 (b) shows the percentage of DERs supplying active power to the grid (active units). It can be seen that, temporarily, 40% of the DERs remain active in the DER\_A\_RT and the detailed models (DER\_D). The 60% that went inactive corresponds to the modern DERs, which enters the permissive operation region (configured as momentary cessation in Category II) when the voltage goes below 0.65 pu. After the fault clearing, the voltage increases, causing the transition from momentary cessation to mandatory operation, and finally, continuous operation.

The latter response does not happen in the DER\_A, so that all DERs remain active. This occurs because the aggregate model, with the recommended parameters, will not start the fractional tripping unless the voltage goes below 0.49 pu. The use of two DER\_A models (one for vintage and another for modern technologies) would improve the tripping response with  $v_{l1} = 0.65$  pu and  $v_{l0} = 0.60$  pu for modern technology. However, if the voltage had remained lower than 0.60 pu for 0.16 s, the DER\_A for modern technology would have tripped, instead of performing a temporary cessation.

The same disturbance was applied with different mixes of modern and vintage technologies. The results of these simulations are summarized in Table II. Regardless of the mix, the simulations with the DER\_A\_RT model provide similar results to those with the detailed models.

#### B. Case 2

A similar disturbance is considered in Case 2, changing the impedance fault to  $15\ \Omega$  and clearing the fault at 250 ms.

The results are presented in Fig. 11. In this case, all the DERs went inactive due to the disturbance. In the DER\_A\_RT and DER\_D, the modern units enter first the cease region, as in Case 1. After that, the old DERs trip because the voltage went under 0.50 pu for more than 0.16 s. Meanwhile, the entire DER\_A model trips before all the individual DERs

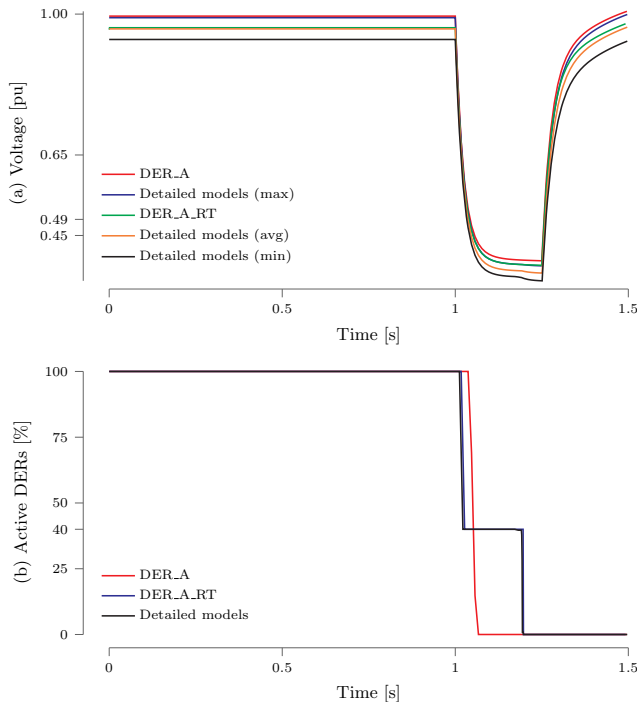


Fig. 11. Response to a three-phase short circuit near bus 4047 with  $15 \Omega$  fault impedance (Case 2).

went inactive. This happened because the voltage went under  $0.44 \text{ pu}$  ( $v_{l0}$ ) for more than  $0.16 \text{ s}$ . Similar to the first case, the DER\_A\_RT better represents the behaviour of individual units by fully modelling the RT and trip characteristics.

### C. Case 3

For the last case, the loss of 40% of the power generated by unit  $g_{20}$  is simulated. This is done to compare the low frequency RT and tripping logic. Figure 12 shows the system frequency and active DERs when the disturbance is applied. In the figure, one of the issues explained in Section III-B is confirmed. In both DER\_A\_RT and detailed models there is a trip of vintage technology when the frequency went below the threshold  $49.42 \text{ Hz}$  for more than  $0.16 \text{ s}$  (see Fig. 9 (a)). This response is not seen in the DER\_A model because the frequency never went below the  $f_l$  threshold, set to  $48.02 \text{ Hz}$ , to take into account the mixed penetration, following the recommendation from [11].

## VI. CONCLUSION

This paper proposes changes to the DER\_A model currently used by several system operators to represent aggregations of DERs units. The changes aim to improve the approximation of the ride-through and tripping of a population of DERs after large disturbances in the transmission system.

By comparing detailed versus aggregate representations of DER units, it was found that the DER\_A model cannot represent all the RT thresholds defined by the IEEE Std. 1547-2018. This limitation is overcome with the proposed DER\_A\_RT model.

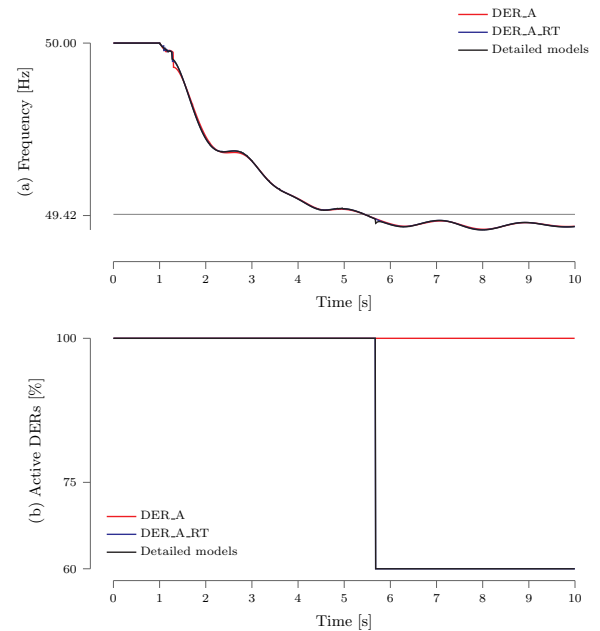


Fig. 12. Response to the loss of 40% of the power generated by unit  $g_{20}$  (Case 3).

It was found that the DER\_A model cannot represent the low-frequency trips in a mixed penetration of old and modern technologies with a single aggregation. Meanwhile, using the modifications proposed in Section IV in two separate aggregations gives a more accurate approximation of the individual DERs active state.

## REFERENCES

- [1] IEEE, "IEEE Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power Systems Interfaces," *IEEE Std 1547-2018 (Revision of IEEE Std 1547-2003)*, pp. 1–138, 2018.
- [2] H. Sun, Q. Guo, J. Qi, V. Ajjarapu, R. Bravo, J. Chow, Z. Li, R. Moghe, E. Nasr-Azadani, U. Tamrakar, G. N. Taranto, R. Tonkoski, G. Valverde, Q. Wu, and G. Yang, "Review of challenges and research opportunities for voltage control in smart grids," *IEEE Transactions on Power Systems*, vol. 34, pp. 2790–2801, 7 2019.
- [3] P. Cicilio, E. Cotilla-Sanchez, B. Vaagensmith, and J. Gentle, "Transmission Hosting Capacity of Distributed Energy Resources," *IEEE Transactions on Sustainable Energy*, vol. 12, pp. 794–801, 4 2021.
- [4] WECC, "WECC PV Power Plant Dynamic Modeling Guide," tech. rep., Western Electricity Coordinating Council (WECC), 2014.
- [5] P. Pourbeik, J. Weber, D. Ramasubramanian, J. Sanchez-Gasca, J. Senthil, P. Zadkhast, J. Boemer, A. Gaikwad, I. Green, S. Tacke, R. Favela, S. Wang, S. Zhu, and M. Torgesen, "An aggregate dynamic model for distributed energy resources for power system stability studies," *Cigre Science & Engineering*, no. 14, pp. 38–48, 2019.
- [6] J. Sancho, F. Escobar, J. Garcia, and G. Valverde, "Comparison of Ride-Through characteristics in aggregate and detailed models of DERs," in *2021 IEEE URUCON (IEEE URUCON 2021)*, (virtual, Uruguay), 11 2021.
- [7] IEEE, "IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems," *IEEE Std 1547-2003*, pp. 1–28, 2003.
- [8] North American Electric Reliability Corporation, "Reliability Guideline: Bulk Power System Reliability Perspectives on the Adoption of IEEE 1547-2018," tech. rep., NERC, 2018.
- [9] IEEE, "IEEE Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power Systems Interfaces—Amendment 1: To Provide More Flexibility for Adoption of Abnormal Operating Performance Category III," *IEEE Std 1547a-2020 (Amendment to IEEE Std 1547-2018)*, pp. 1–16, 2020.

- [10] EPRI, “The New Aggregated Distributed Energy Resources (DER\_A) Model for Transmission Planning Studies: 2019 Update,” tech. rep., Electric Power Research Institute (EPRI), 2019.
- [11] North American Electric Reliability Corporation, “Reliability Guideline: Parameterization of the DER A Model,” tech. rep., NERC, 2019.
- [12] J. García, J. Viquez, J. Incer, F. Escobar, P. Aristidou, and G. Valverde, “Modeling Framework and Coordination of DER and Flexible Loads for Ancillary Service Provision,” in *Proceedings of the 54th Hawaii International Conference on System Sciences*, p. 3111, Hawaii International Conference on System Sciences, 1 2021.
- [13] IEEE, “IEEE Standard for Interconnection and Interoperability of Inverter-Based Resources (IBRs) Interconnecting with Associated Transmission Electric Power Systems,” *IEEE Std 2800-2022*, pp. 1–180, 2022.
- [14] P. Aristidou, S. Lebeau, and T. Van Cutsem, “Power system dynamic simulations using a parallel two-level Schur-complement decomposition,” *IEEE Trans. Power Syst.*, vol. 31, pp. 3984–3995, Sept. 2016.
- [15] F. Escobar, J. García, J. M. Viquez, G. Valverde, and P. Aristidou, “A Combined High-, Medium-, and Low-Voltage Test System for Stability Studies with DERs,” *Electric Power Systems Research*, vol. 189, 12 2020.
- [16] T. Van Cutsem, M. Glavic, W. Rosehart, C. Canizares, M. Kanatas, L. Lima, F. Milano, L. Papangelis, R. A. Ramos, J. A. D. Santos, B. Tamimi, G. Taranto, and C. Vournas, “Test Systems for Voltage Stability Studies,” *IEEE Transactions on Power Systems*, vol. 35, pp. 4078–4087, 9 2020.